


DOCUMENTO No.	
LP013ES ANEXO 1	
REVISIÓN	EMISIÓN
0	Marzo 2019

ESPECIFICACION GRAFICA PARA BOMBA 94100

CURVA DE OPERACION

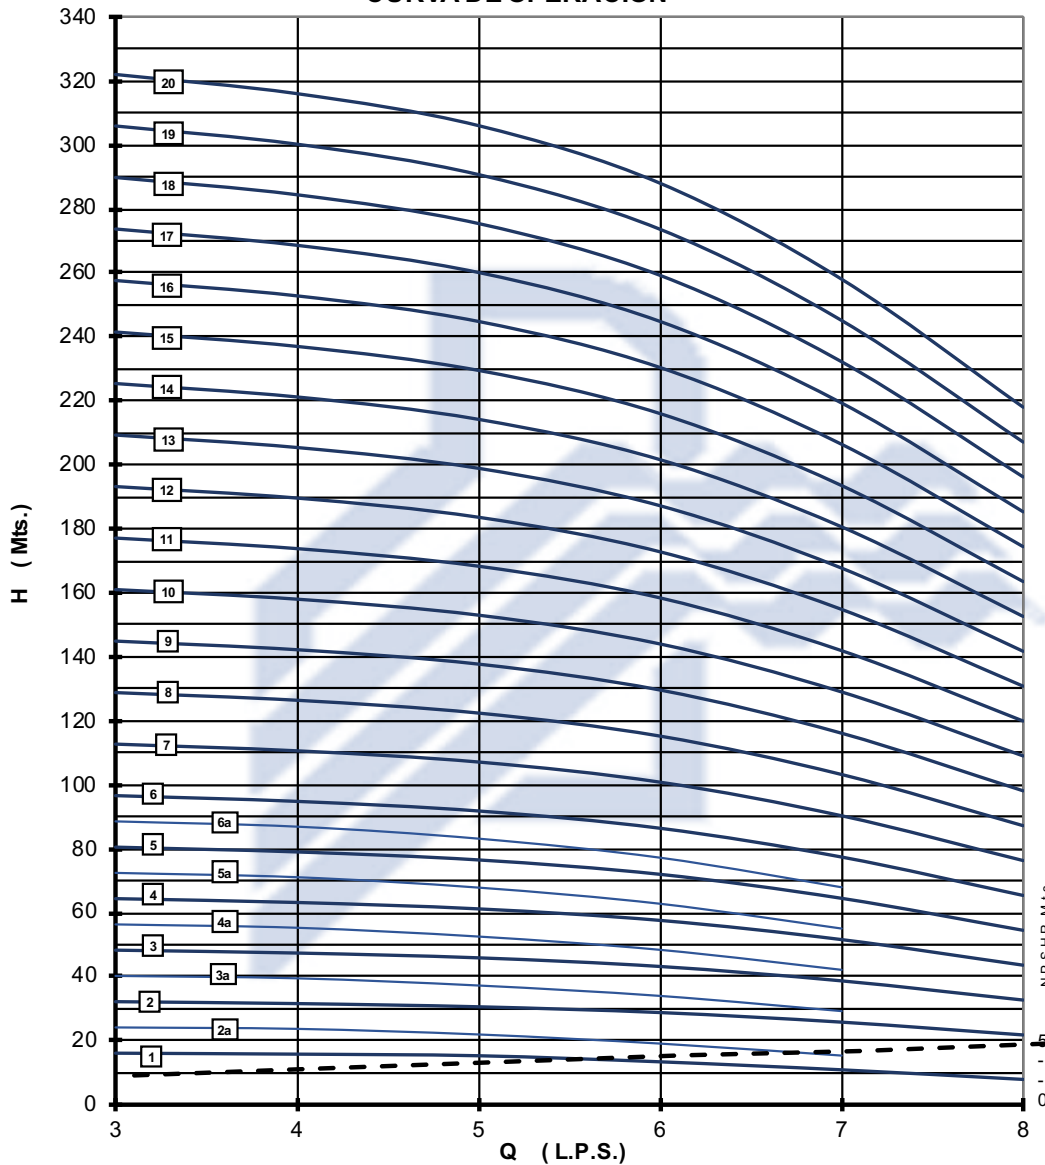

COMBINACIONES	
Bomba	Motor
N° DE PASOS	MS acoplado
1a	4 / 6
1	4 / 6
2a	4 / 6
2	4 / 6
3a	7 / 6
3	7 / 6
4a	7 / 6
4	7 / 6
5a	10 / 6
5	10 / 6
6a	10 / 6
6	10 / 6
7	15/6 - 15/8
8	15/6 - 15/8
9	15/6 - 15/8
10	20/6 - 20/8
11	20/6 - 20/8
12	20/6 - 20/8
13	25/6 - 25/8
14	25/6 - 25/8
15	25/6 - 25/8
16	30/6 - 30/8
17	30/6 - 30/8
18	30/6 - 30/8
19	40/6 - 40/8
20	40/6 - 40/8

CORRECCIÓN DE EFICIENCIA	
N° Pasos	Puntos %
1	- 4
2	- 3
3	- 2
4	- 1
5	- 0

OBSERVACIONES:
* La bomba operará en cualquier punto de la curva.
* Máx. temperatura agua 30°C.
* Temperatura Mayor a 31° C. consultar con fábrica.
Modelo: 94100
60 Ciclos, 2 Polos, 3500 RPM

